

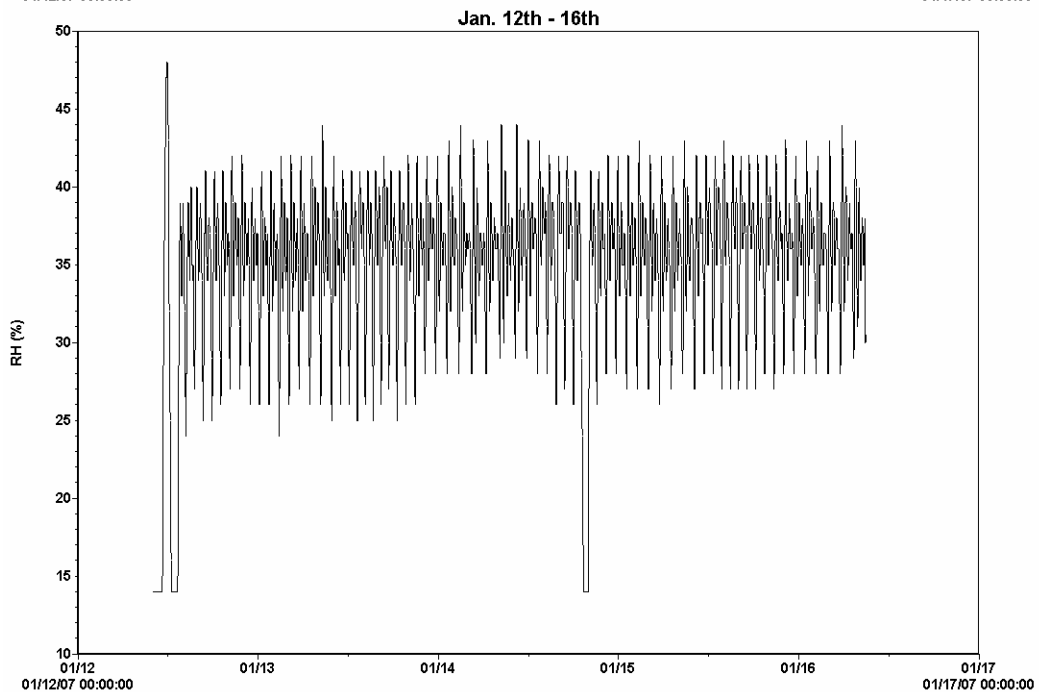
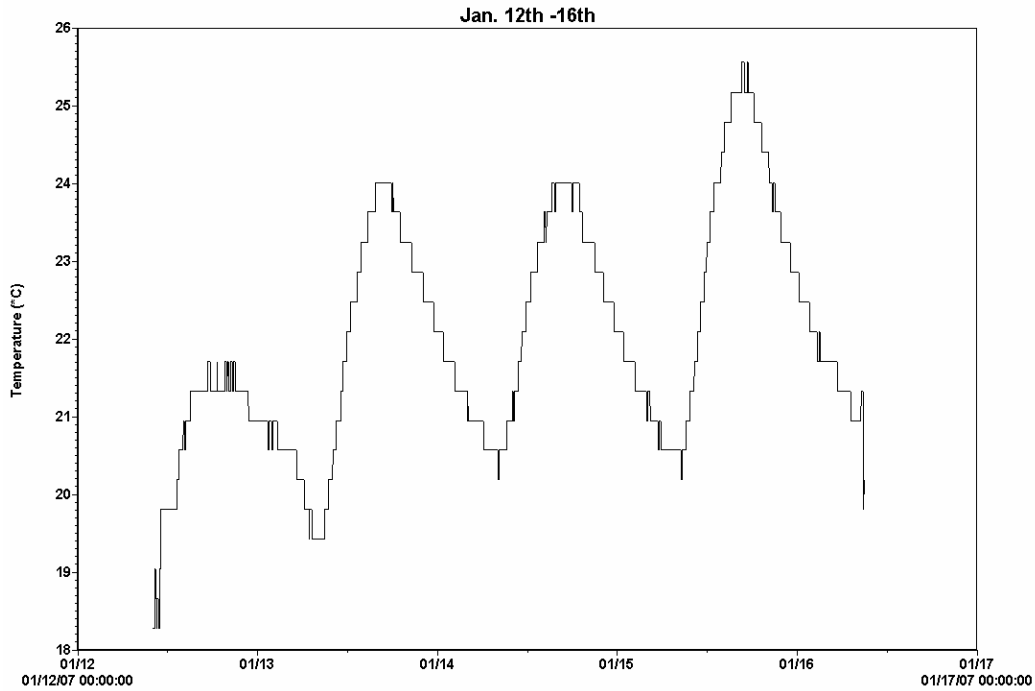


Room 105 HVAC System Performance (1)

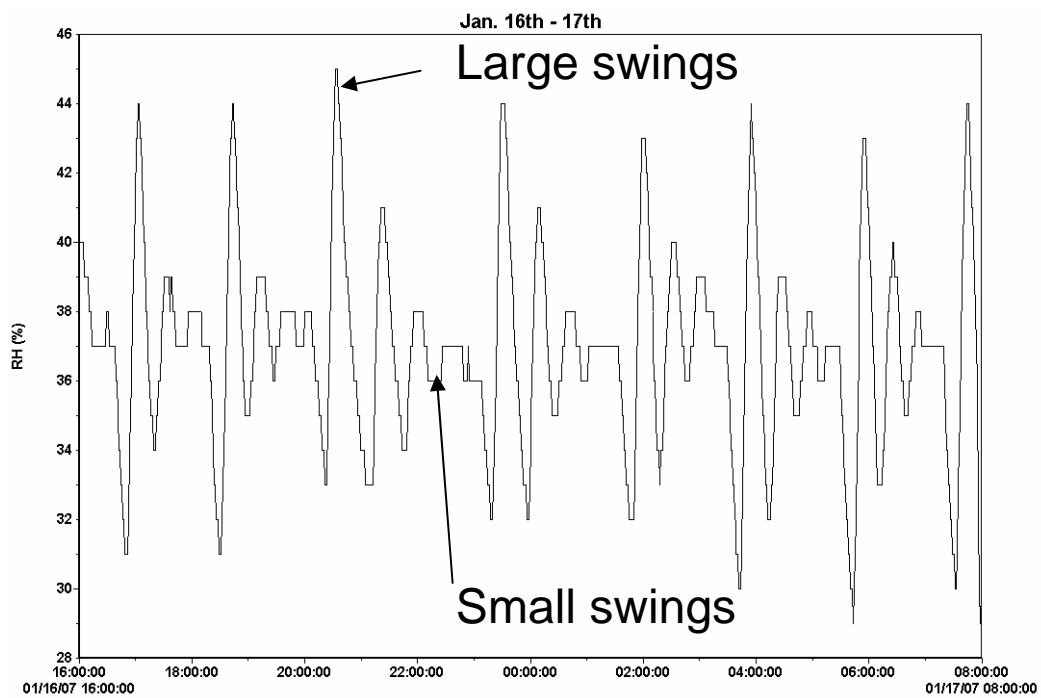

Borrowed datalogger from LCLS laser folks ...

Room 105 HVAC System Performance (2)

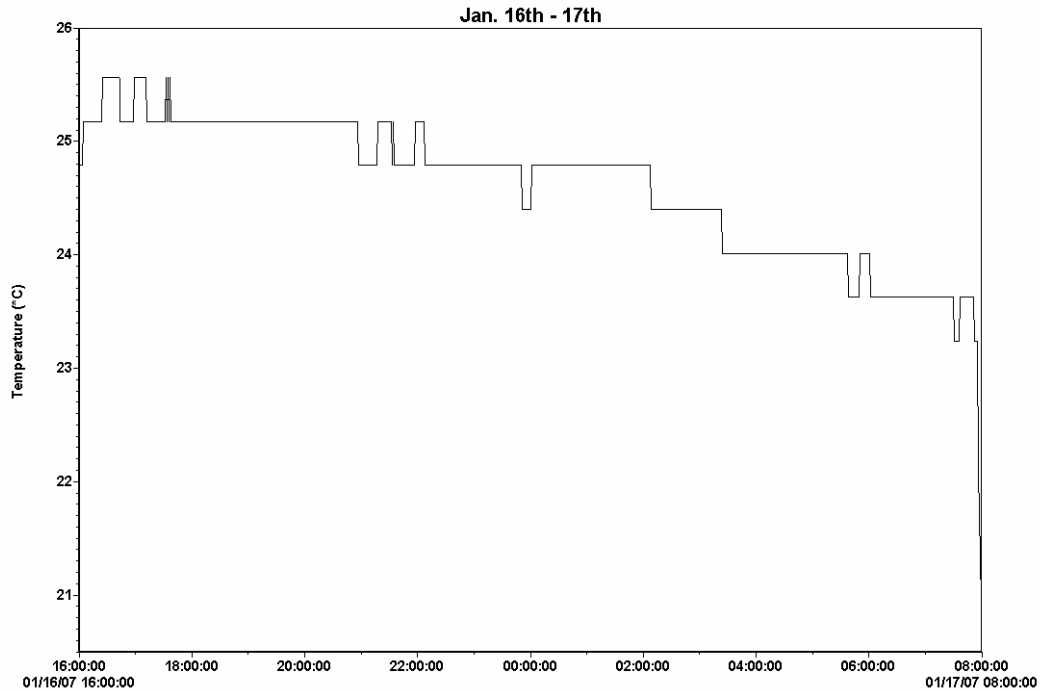

Need to clarify how feedback and control works.

Remaining issues

- Fix start up problems with HVAC (HS wants to install new voltage control unit).
- Apparently HVAC experts agreed to share their control system.
- Electrical work should be finished today.
- Final checkout and approval of Laser Safety System once electrical work is done.