

Renewal Energy Application to ILC

T. Saeki (KEK)

15 May 2014


AWLC2014 at FNAL

Improve Efficiency of Power Consumption in Accelerator Operation

Green ILC



serious issue for ILC

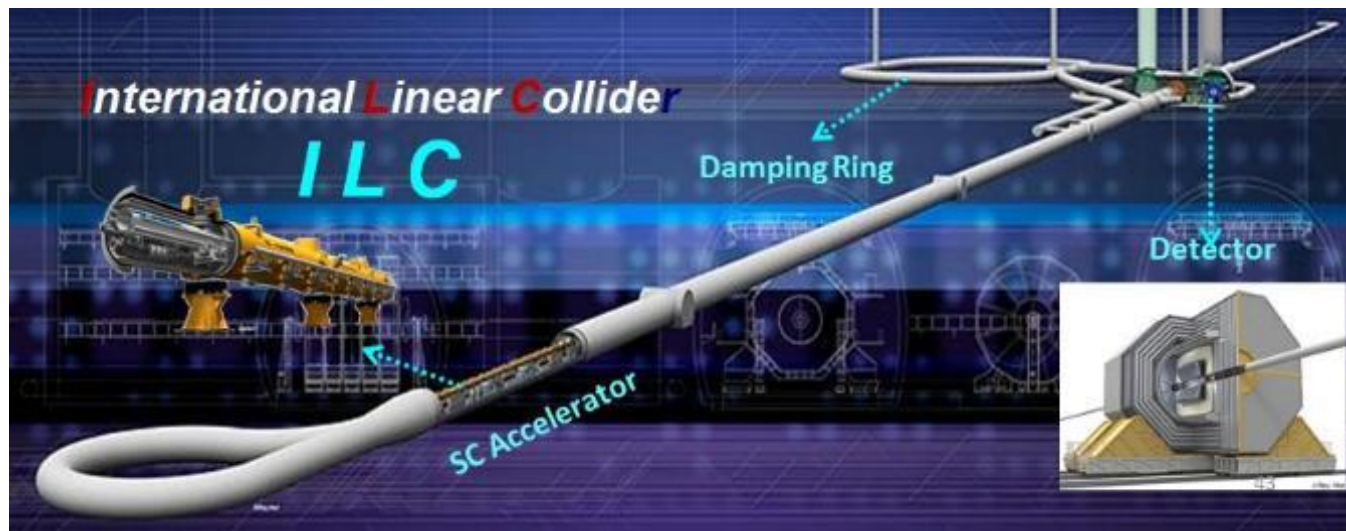



.....
CERN, GENEVA, SWITZERLAND, 23-25 OCTOBER 2013
.....

Energy Management in Japan, Consequences for Research Infrastructures

Masakazu Yoshioka (KEK)

1. Electric power supply in Japan, before and after March 11, 2011 earthquake
 - High efficiency and “almost” environmental pollution-free electricity generators can save Japan, and contribute to reduce global CO₂ problem
2. KEK Electricity contract as an example of large-scale RIs
3. Accelerator design by considering optimization of luminosity/electricity demand
 - Example: Super-KEKB
 - ILC
4. Accelerator component design by considering high power-efficiency
 - Klystron
 - Availability based on MTBF and MTTR
5. Summary

ILC: an amazing energy transformer

FROM eV TO TeV:



THE GREEN ILC

2nd Energy for Sustainable
Sciences, CERN Oct 2013

Denis Perret-Gallix
LAPP/IN2P3-CNRS (France)

1

Energy Management at KEK,
Strategy on Energy Management,
Efficiency, Sustainability

Atsuto Suzuki (KEK)



INTER-UNIVERSITY RESEARCH INSTITUTE CORPORATION
HIGH ENERGY ACCELERATOR RESEARCH ORGANIZATION

Power Balance of Consumption and Loss in ILC

Requirements from Physics Exp.


- Basic requirements:

- Luminosity : $\int L dt = 500 \text{ fb}^{-1}$ in 4 years
- E_{cm} : scan 200 – 500 GeV and the ability to
- E stability and precision: $< 0.1\%$
- Electron polarization: $> 80\%$

- Extension capability:

- Energy upgrade: 500 \rightarrow 1,000 GeV

**ILC 500 GeV
Total Power
:
~200 MW**

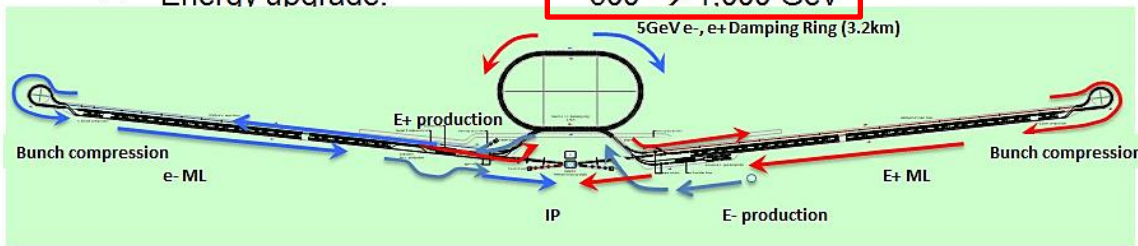

Improve efficiency

Infrastructure : 50 MW

RF System : 70 MW

Cryogenics : 70 MW

Beam Dump : 10 MW

200 MW

loss rate

50 % : 25 MW

50 % : 35 MW

90 % : 60 MW

100 % : 10 MW

~ 130 MW

Obligation to Us

Increase recovery

Activities for Green ILC

- Three presentations were given (by A. Suzuki, D. Perret-Gallix, and M. Yoshioka) in 2nd WS “Energy for Sustainable Science at Research Infrastructure” at CERN in Oct. 2013.
- A session (four presentations) was organized for Green-ILC activities in LCWS 2013 at Tokyo in Nov. 2013. A. Suzuki also presented Green-ILC activities in the plenary session in LCWS 2013.
- Green-ILC Working Group was organized in “Advanced Accelerator Association promoting science & technology (AAA) in Tokyo/Japan. The 1st meeting for the Green-ILC WG of AAA was held on 25th February 2014. (AAA home page = https://aaa-sentan.org/en/about_us.html)
- 2nd Green-ILC WG meeting was held on 5th May 2014 in Tokyo/Japan. Some realistic technologies of energy-saving for ILC were proposed and discussed by industries and scientists.
- D. Perret-Gallix is preparing the interactive home page of Green-ILC and is going to launch it soon.


Advanced Accelerator Association promoting science & technology (AAA)

Association by industries and scientists

- 96 corporate organizations involved from industries (MHI, Toshiba, Hitachi, Mitsubishi Electronics, etc.) as of May 2014.
- 40 institutional organizations involved from universities and laboratories (KEK, Univ. of Tokyo, Univ. of Tohoku, Univ. of Kyoto, Riken, etc.) as of May 2014.



Green-ILC WG started in
Technology Study Group
on 25th Feb. 2014.

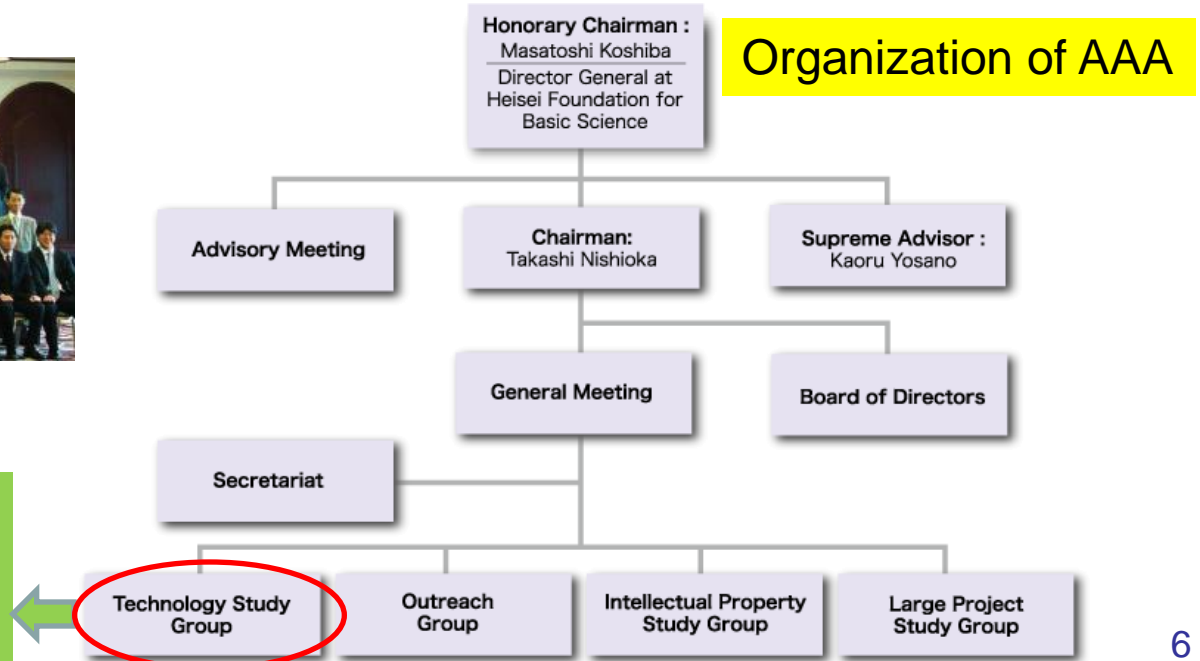

Agenda for the 2nd AAA Green-ILC WG meeting

Date: 8th May 2014 (Thu.) 13:30 - 17:00.

Place: 6th floor, UDX Building in Akihabara, Tokyo.

- 1) **Collector Potential Depression (CPI) Klystron** (30 min.)
by Toshiba Electron Tubes & Devices Co. Ltd.
- 2) **Power Saving of Large-Scaled Helium Compressor** (30 min.)
by Mayekawa Manufacturing Company.
- 3) **Examples of New Energy Power Plants** (20 min.)
by RIKEN.
- 4) **Solar Power Plant** (40 min.)
by Japan Photovoltaic Energy Association
- 5) **Proposal of Biomass Power Plant for ILC** (20 min.)
by Kabuki Construction Co. Ltd.

Agenda for the 2nd AAA Green-ILC WG meeting

Date: 8th May 2014 (Thu.) 13:30 - 17:00.

Place: 6th floor, UDX Building in Akihabara, Tokyo.


- 1) Collector Potential Depression (CPI) Klystron (30 min.)
by Toshiba Electron Tubes & Devices Co. Ltd.**
- 2) Power Saving of Large-Scaled Helium Compressor (30 min.)
by Mayekawa Manufacturing Company.**
- 3) Examples of New Energy Power Plants (20 min.)
by RIKEN.**
- 4) Solar Power Plant (40 min.)
by Japan Photovoltaic Energy Association**
- 5) Proposal of Biomass Power Plant for ILC (20 min.)
by Kabuki Construction Co. Ltd.**

How to Improve RF Efficiency


R&D of CPD (Collector Potential Depression) Klystron

CPD is an energy-saving scheme that recovers the kinetic energy of the spent electrons after generating rf power.

Conventional

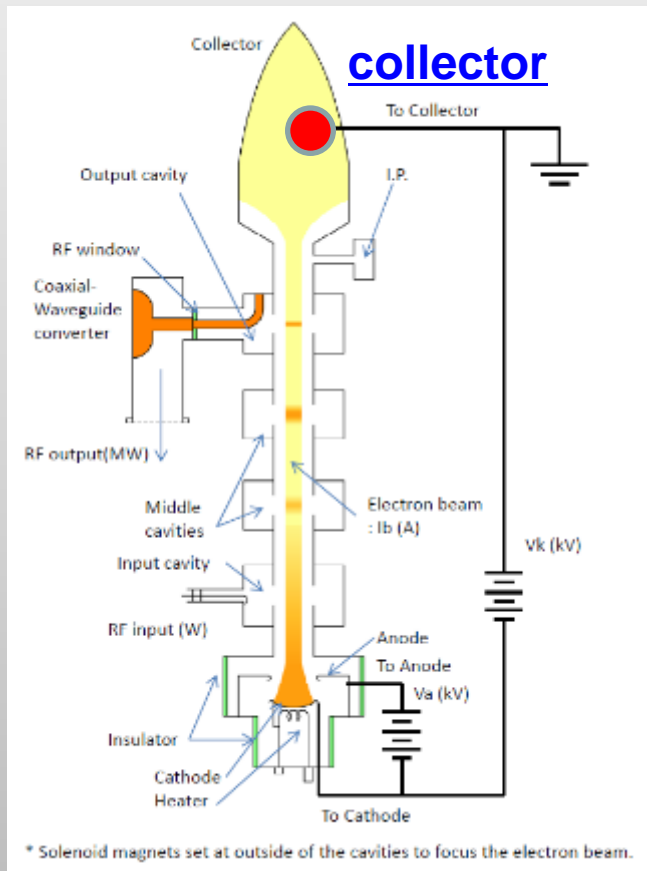

Schematic diagram of CPD

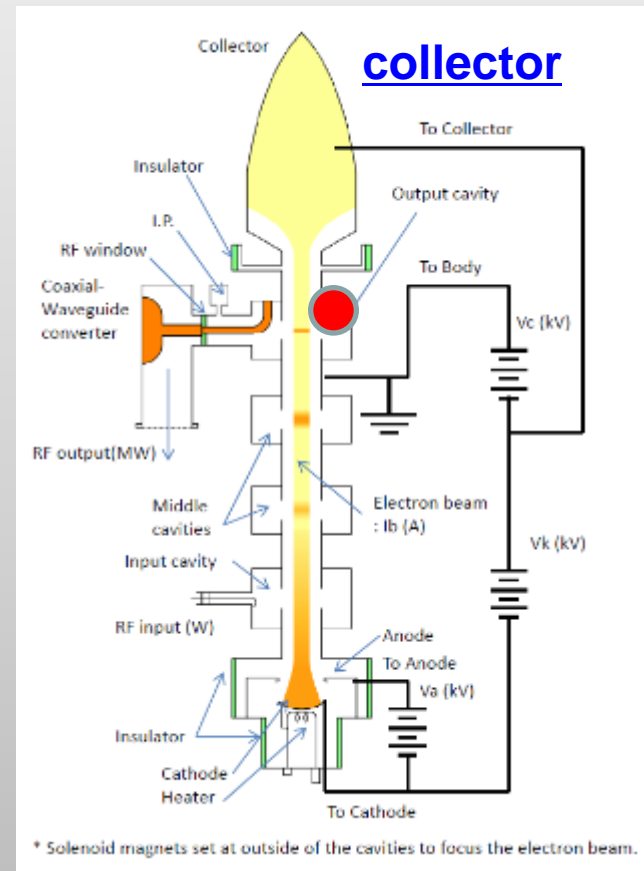

Multi(6) – Beam Klystron (MBK) for 26 Cavities

for II C

DEVELOPMENT OF TOSHIBA L-BAND MULTI-BEAM KLYSTRON FOR EUROPEAN XFEL PROJECT

Y. H. Chin, KEK, Tsukuba, Japan,

A. Yano, S. Miyake, TOSHIBA ELCTRON TUBES & DEVICES Co., Ltd., Ohtawa-shi, Japan,

S. Choroba, DESY, Hamburg, Germany

- The design goal is to achieve 10 MW peak power with 65 % efficiency at 1.5 ms pulse length at 10 Hz repetition rates.
- MBK has 6 low-perveance beams operated at low voltage of 115 kV for 10 MW to enable a higher efficiency than a single-beam klystron.

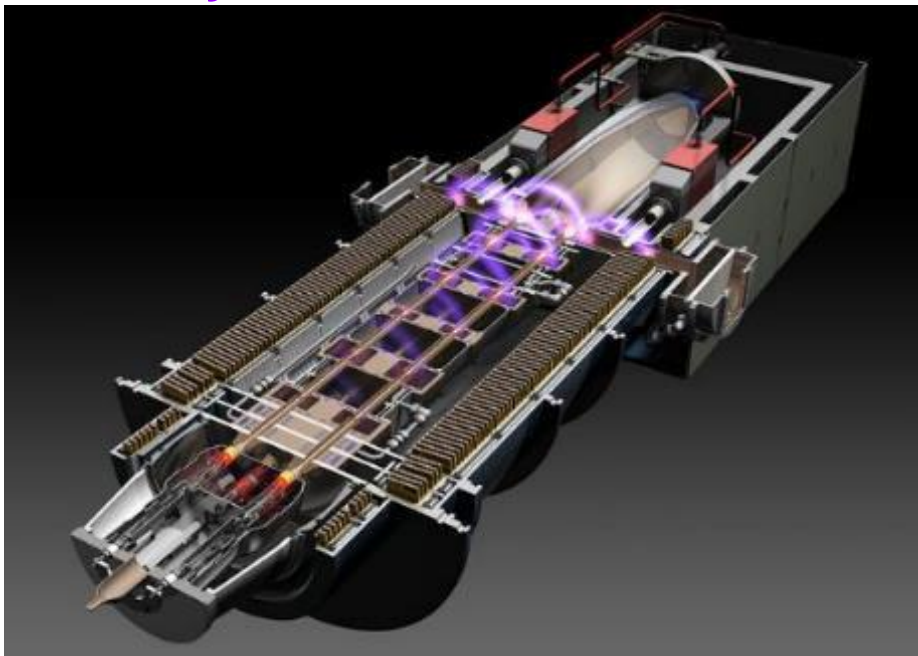


Figure 2: Electron Gun of the E3736.

Frequency	1.3 GHz
Peak power	10 MW
Pulse width	1.6 ms
Rep. rate	5 Hz
Average power	78 kW
Efficiency	65 %
Gain	47dB
BW (- 1dB)	3 MHz
Voltage	120 kV
Current	140 A
Lifetime	40,000 h

Present Status of R&D

Target

proof-of-principle of CPD in the unsaturated region (a maximum rf power of 500 kW) using a KEKB 1.2MW-klystron

R&D Schedule

2013.3: Modification of an existing klystron to CPD klystron (already done)

2014.3: until then, preparation and commissioning of the test station

~2014: Verification of klystron operation without CPD


~2015: Measurement of rf leakage from the gap between the body column and the collector (with no CPD voltage applied)

Measurement of induced pulse voltage on the collector with CPD

~2017: Test of rectification by Marx circuit

Integration test of the proof-of-principle of CPD operation

Goal : 80 % efficiency

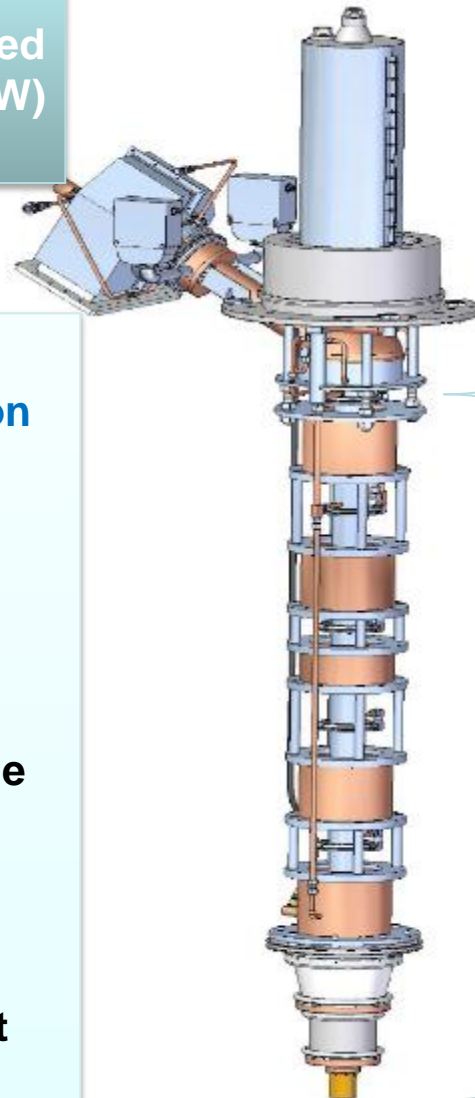

Newly fabricated components

- collector
- ceramic insulator
- output cavity
- output coupler

Recycled components

- electron gun
- input cavity
- intermediate cavities




Agenda for the 2nd AAA Green-ILC WG meeting

Date: 8th May 2014 (Thu.) 13:30 - 17:00.

Place: 6th floor, UDX Building in Akihabara, Tokyo.


- 1) Collector Potential Depression (CPI) Klystron (30 min.)
by Toshiba Electron Tubes & Devices Co. Ltd.**
- 2) Power Saving of Large-Scaled Helium Compressor (30 min.)
by Mayekawa Manufacturing Company.**
- 3) Examples of New Energy Power Plants (20 min.)
by RIKEN.**
- 4) Solar Power Plant (40 min.)
by Japan Photovoltaic Energy Association**
- 5) Proposal of Biomass Power Plant for ILC (20 min.)
by Kabuki Construction Co. Ltd.**

Heat source from the helium compressor

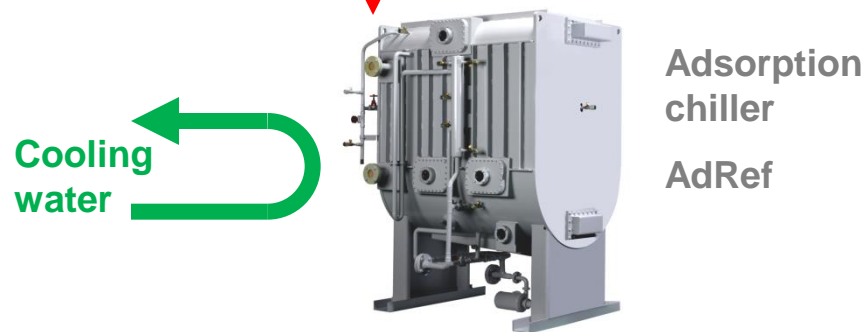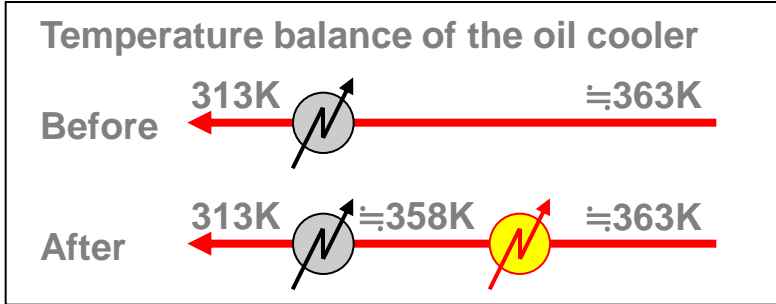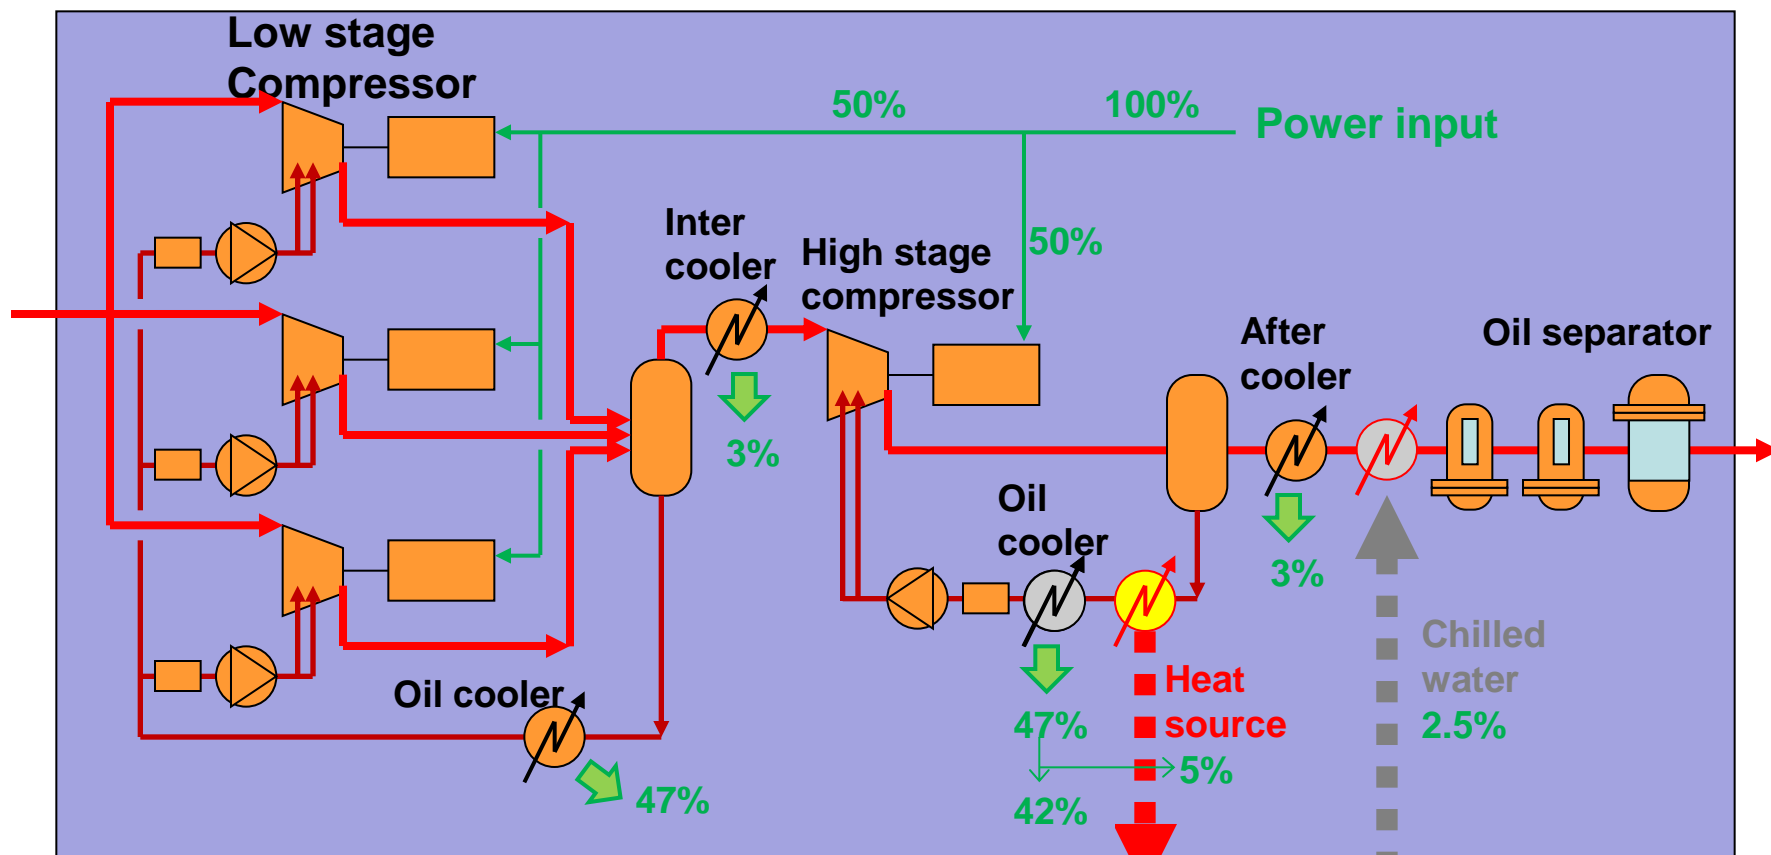

New refrigeration cycle with AdRef


4.25MW(100%)

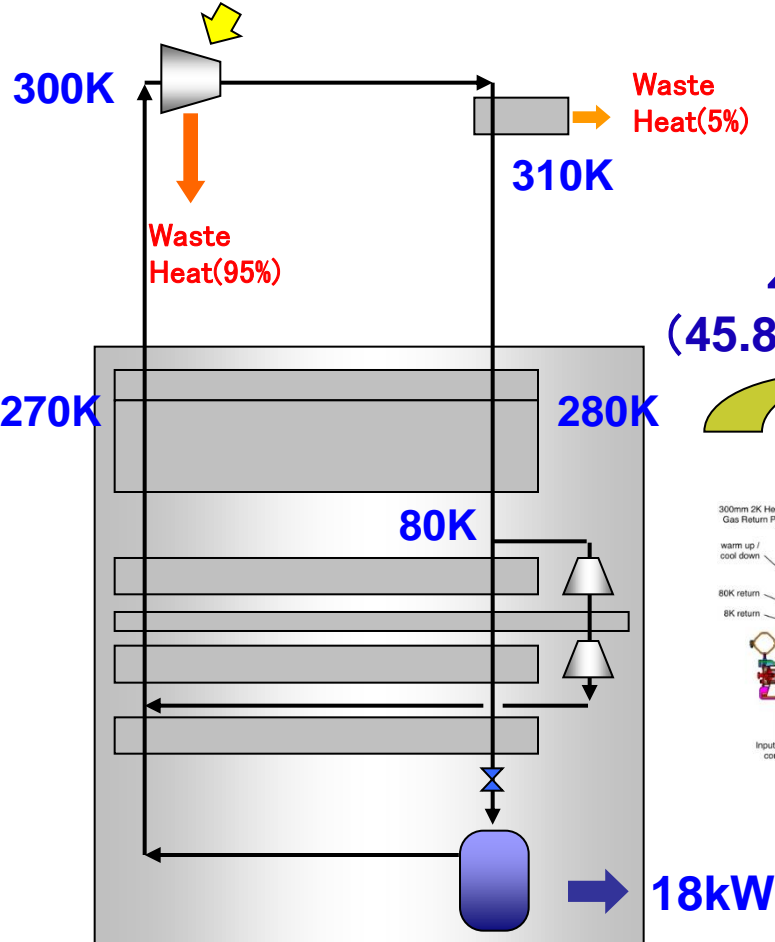


Conventional cycle

Low suction temp.
 →small compressor
 →small power consumption

ILC
 $\Delta 3\text{MW}$
 (45.81 → 42.79MW)

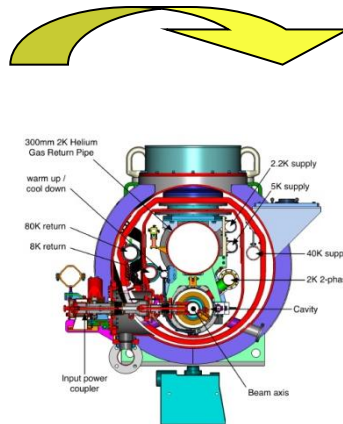

3.97MW(93%)

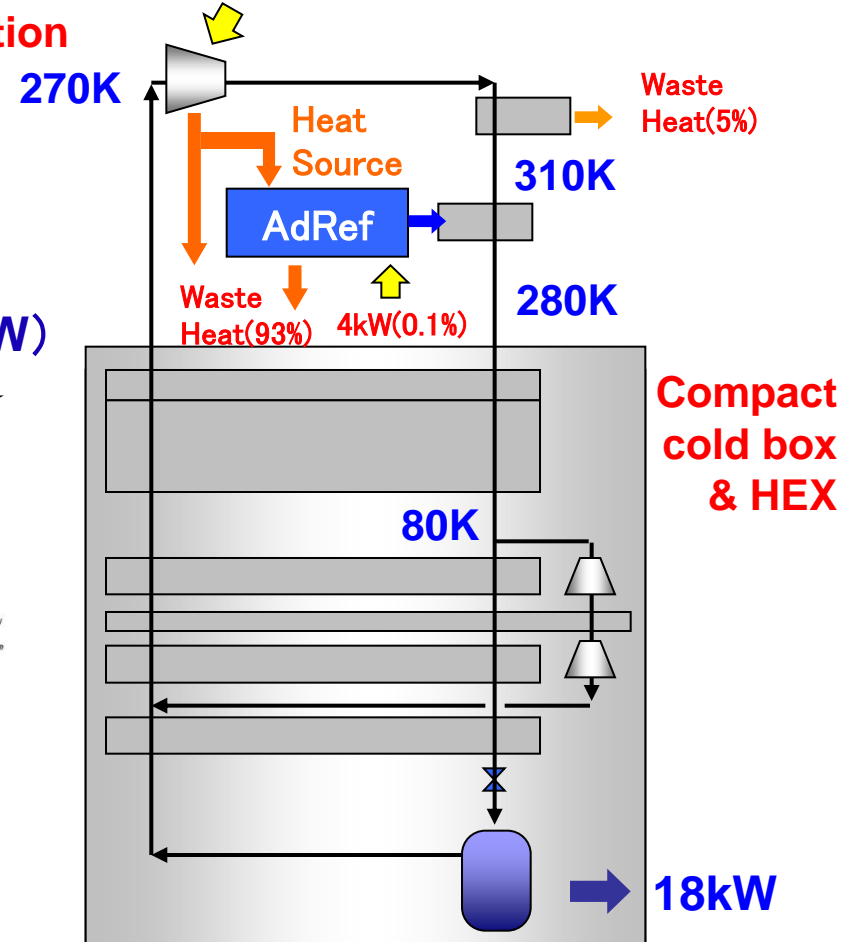

New cycle with AdRef

Agenda for the 2nd AAA Green-ILC WG meeting


Date: 8th May 2014 (Thu.) 13:30 - 17:00.

Place: 6th floor, UDX Building in Akihabara, Tokyo.

- 1) Collector Potential Depression (CPI) Klystron (30 min.)
by Toshiba Electron Tubes & Devices Co. Ltd.**
- 2) Power Saving of Large-Scaled Helium Compressor (30 min.)
by Mayekawa Manufacturing Company.**
- 3) Examples of New Energy Power Plants (20 min.)
by RIKEN.**
- 4) Solar Power Plant (40 min.)
by Japan Photovoltaic Energy Association**
- 5) Proposal of Biomass Power Plant for ILC (20 min.)
by Kabuki Construction Co. Ltd.**



CGS(Co-Generation System) at RIKEN

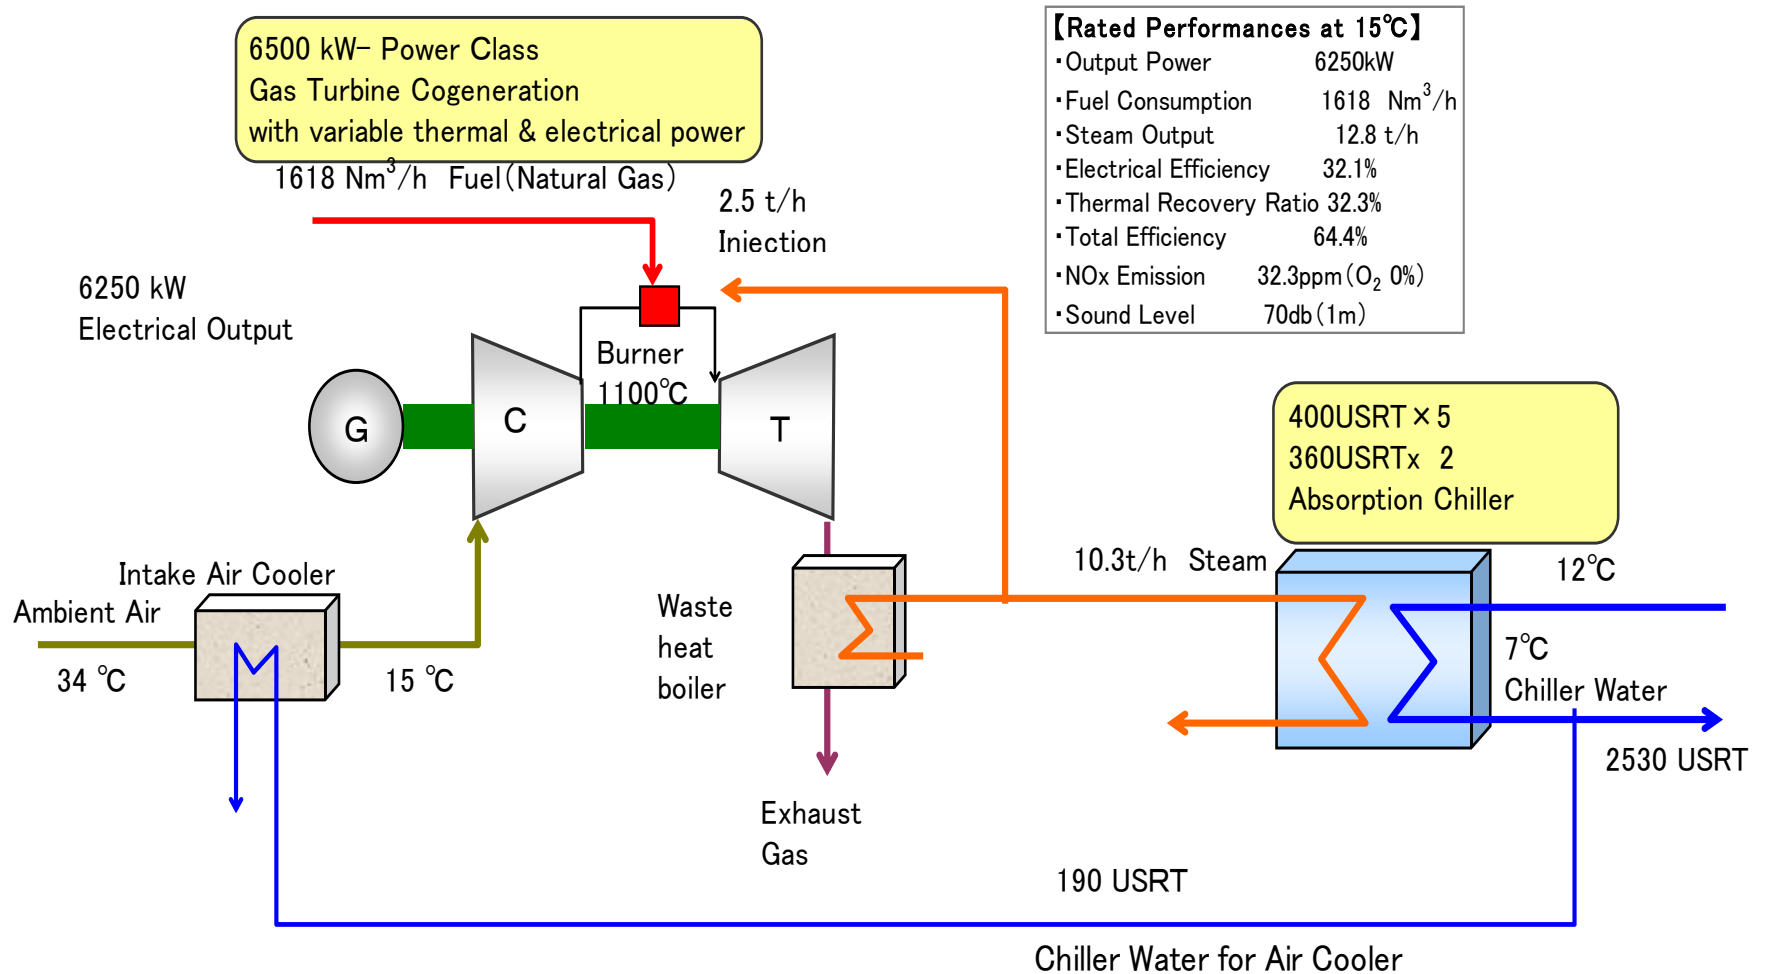


CGS (Go-Generation System) at RIKEN

- 6.5 MW + 2720 USRT
- 1Hz (20msec) power switch for blackout.
- Efficiency : 68%, as of June 2010.




- G : 7MVA. 6.6kV. 50Hz.
- T : 1100°C/480°C. 14000rpm. 6.6MW /12°C.
- B : 480°C/160°C. 1.6MPa(210°C)12.5t/h
- C : 400 USRT x 5 + 360 USRT x 2, 7°C at outlet (1 USRT=3.52kW.)

Power Line Circuit

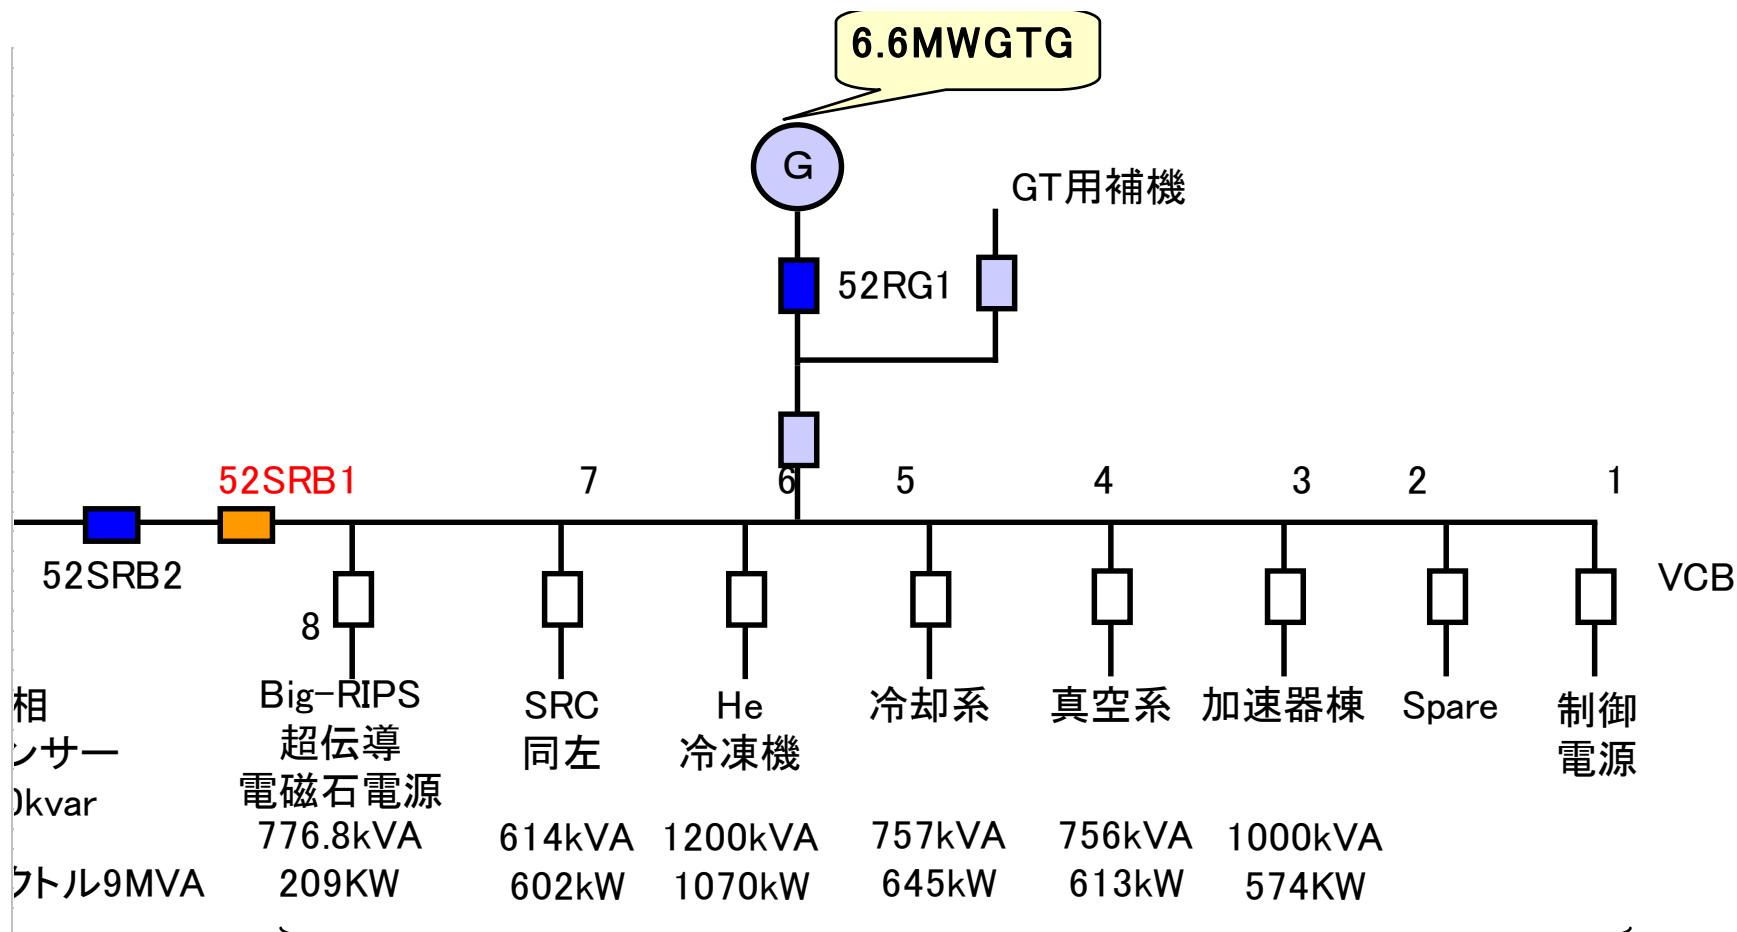

CGS母線負荷

Power Line Circuit

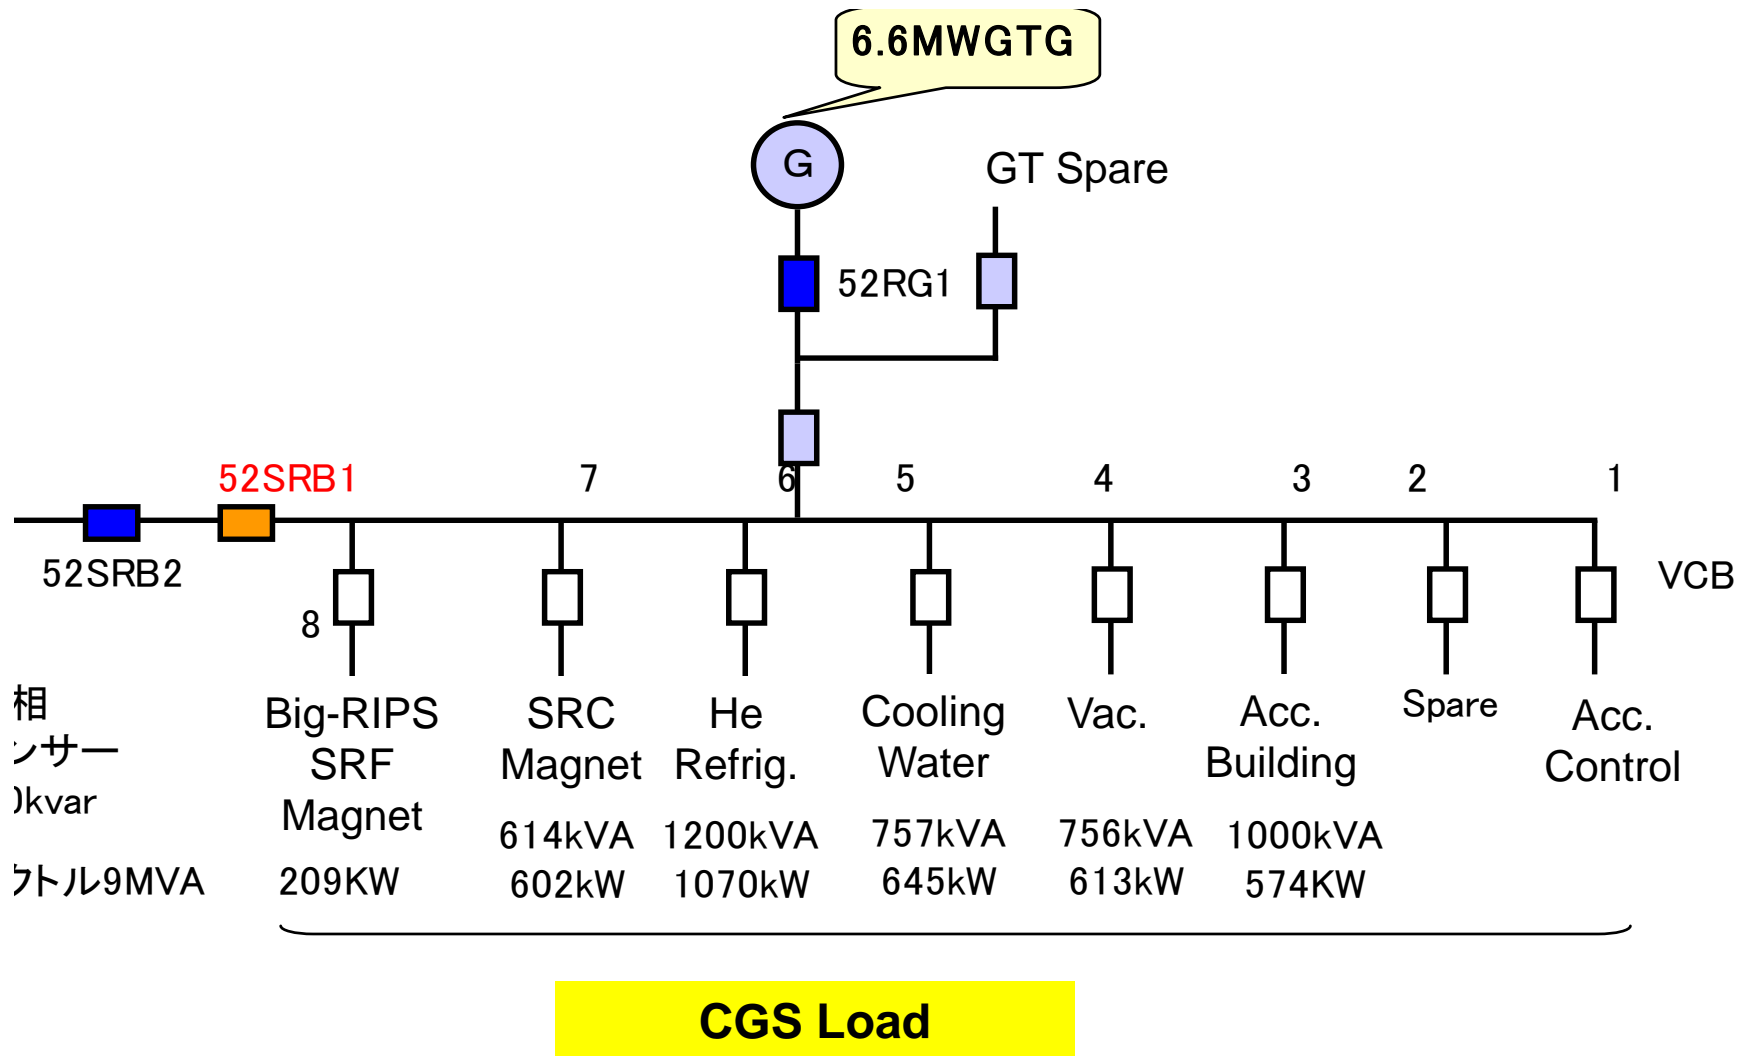

Agenda for the 2nd AAA Green-ILC WG meeting

Date: 8th May 2014 (Thu.) 13:30 - 17:00.

Place: 6th floor, UDX Building in Akihabara, Tokyo.

- 1) Collector Potential Depression (CPI) Klystron (30 min.)
by Toshiba Electron Tubes & Devices Co. Ltd.**
- 2) Power Saving of Large-Scaled Helium Compressor (30 min.)
by Mayekawa Manufacturing Company.**
- 3) Examples of New Energy Power Plants (20 min.)
by RIKEN.**
- 4) Solar Power Plant (40 min.)
by Japan Photovoltaic Energy Association**
- 5) Proposal of Biomass Power Plant for ILC (20 min.)
by Kabuki Construction Co. Ltd.**

Solar Power Production / Top 6 Countries




Integrated Installation (2012)

2012年暦年末までの累積導入量	
ドイツ	32,462MW
イタリア	16,450 MW
米国	7,272MW
中国	6,800MW
日本	6,632MW
スペイン	4,706MW
全世界	99,262MW

German

Japan

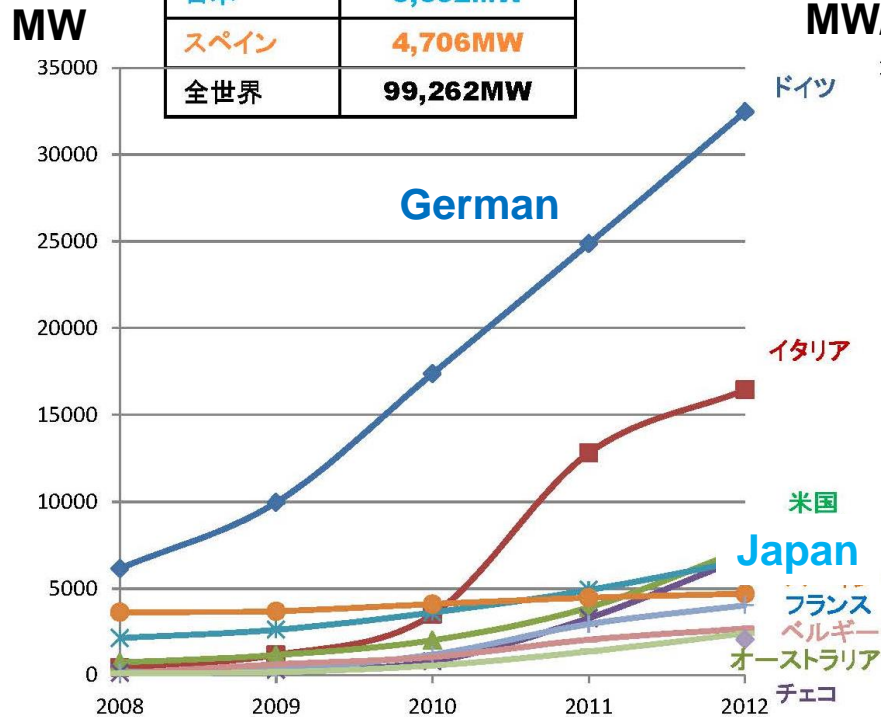


Installation per Year (2012)

2012年暦年の年間導入量	
ドイツ	7,604 MW
イタリア	3,647 MW
中国	3,500MW
米国	3,362MW
日本	1,718MW
フランス	1,079MW
全世界	29,665MW

German

Japan


MW/Y

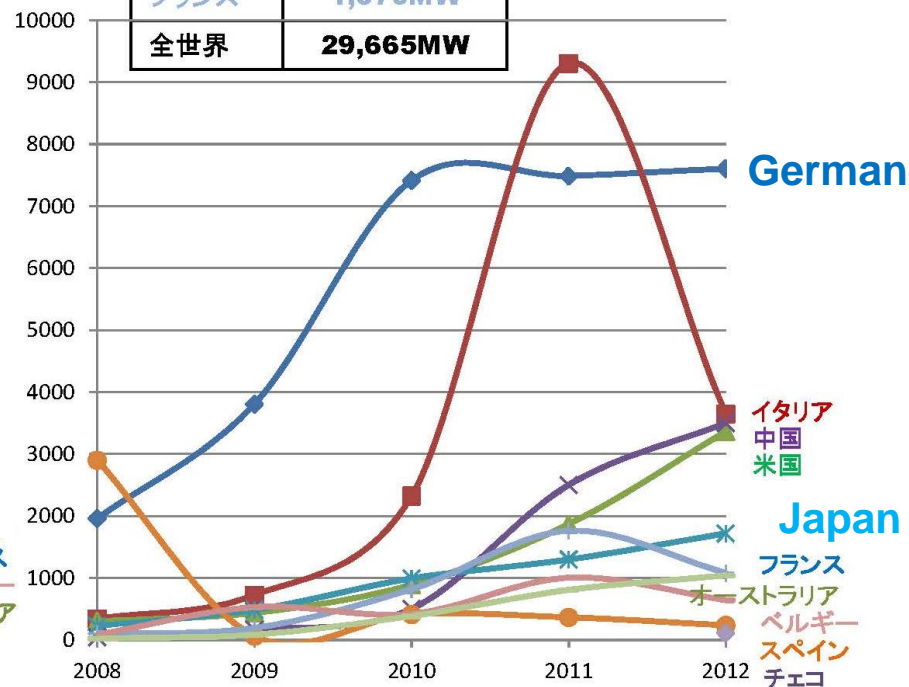

出典: TRENDS 2013 Report IEA-PVPS T1-23:2013

16

Projection of Solar Power Production in Japan by IEA

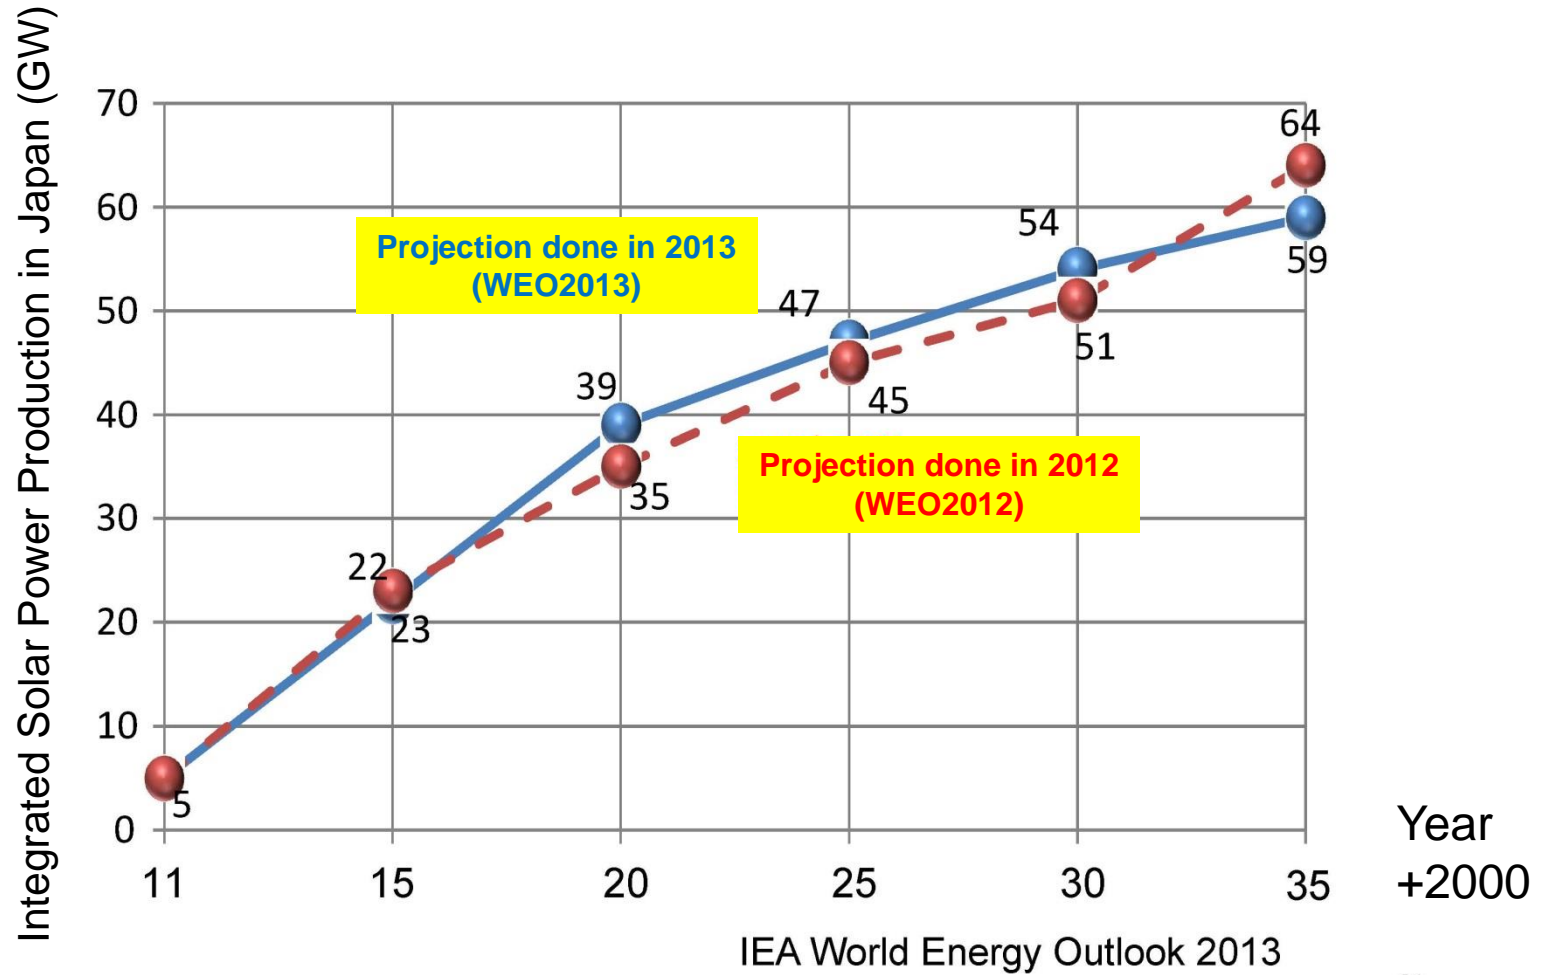


Weekly Production in Germany (2012)



Electricity Production in Germany: Calendar Week 36


Actual production

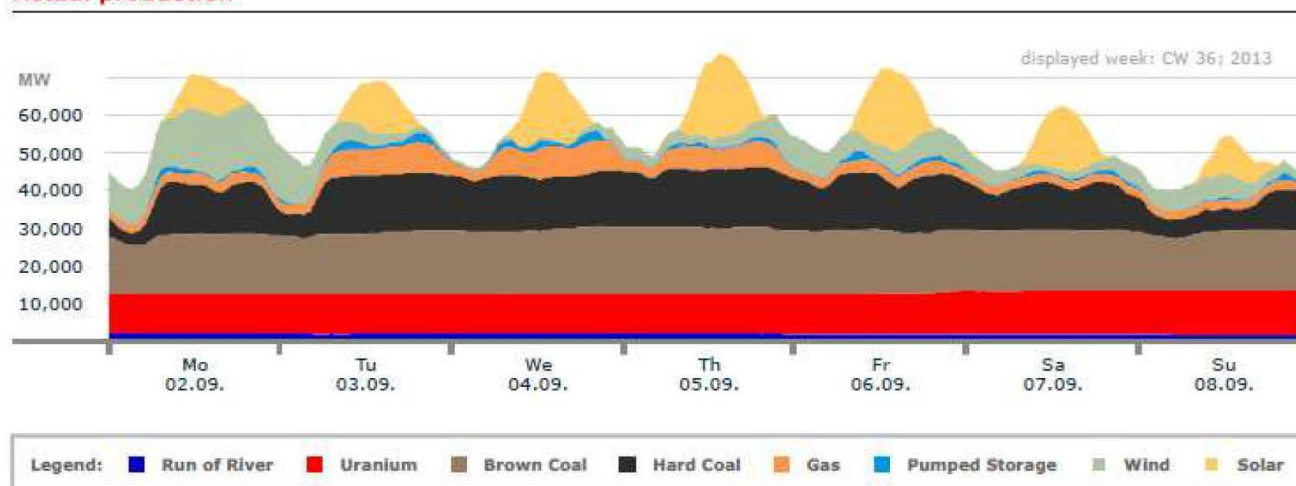

	RoR	Uran	BC	HC	Gas	PSt	Wind	Solar
min. power (GW)	1.5	10.3	12.7	3.2	2	0	0.1	0
max. power (GW)	2	11.9	17.8	16	8.7	2.8	17	22
weekly energy (TWh)	0.3	1.8	2.7	2	0.7	0.1	0.9	0.8

Graph: Bruno Burger, Fraunhofer ISE; Data: EEX Transparency Platform

Smart Country by Smart GRIG

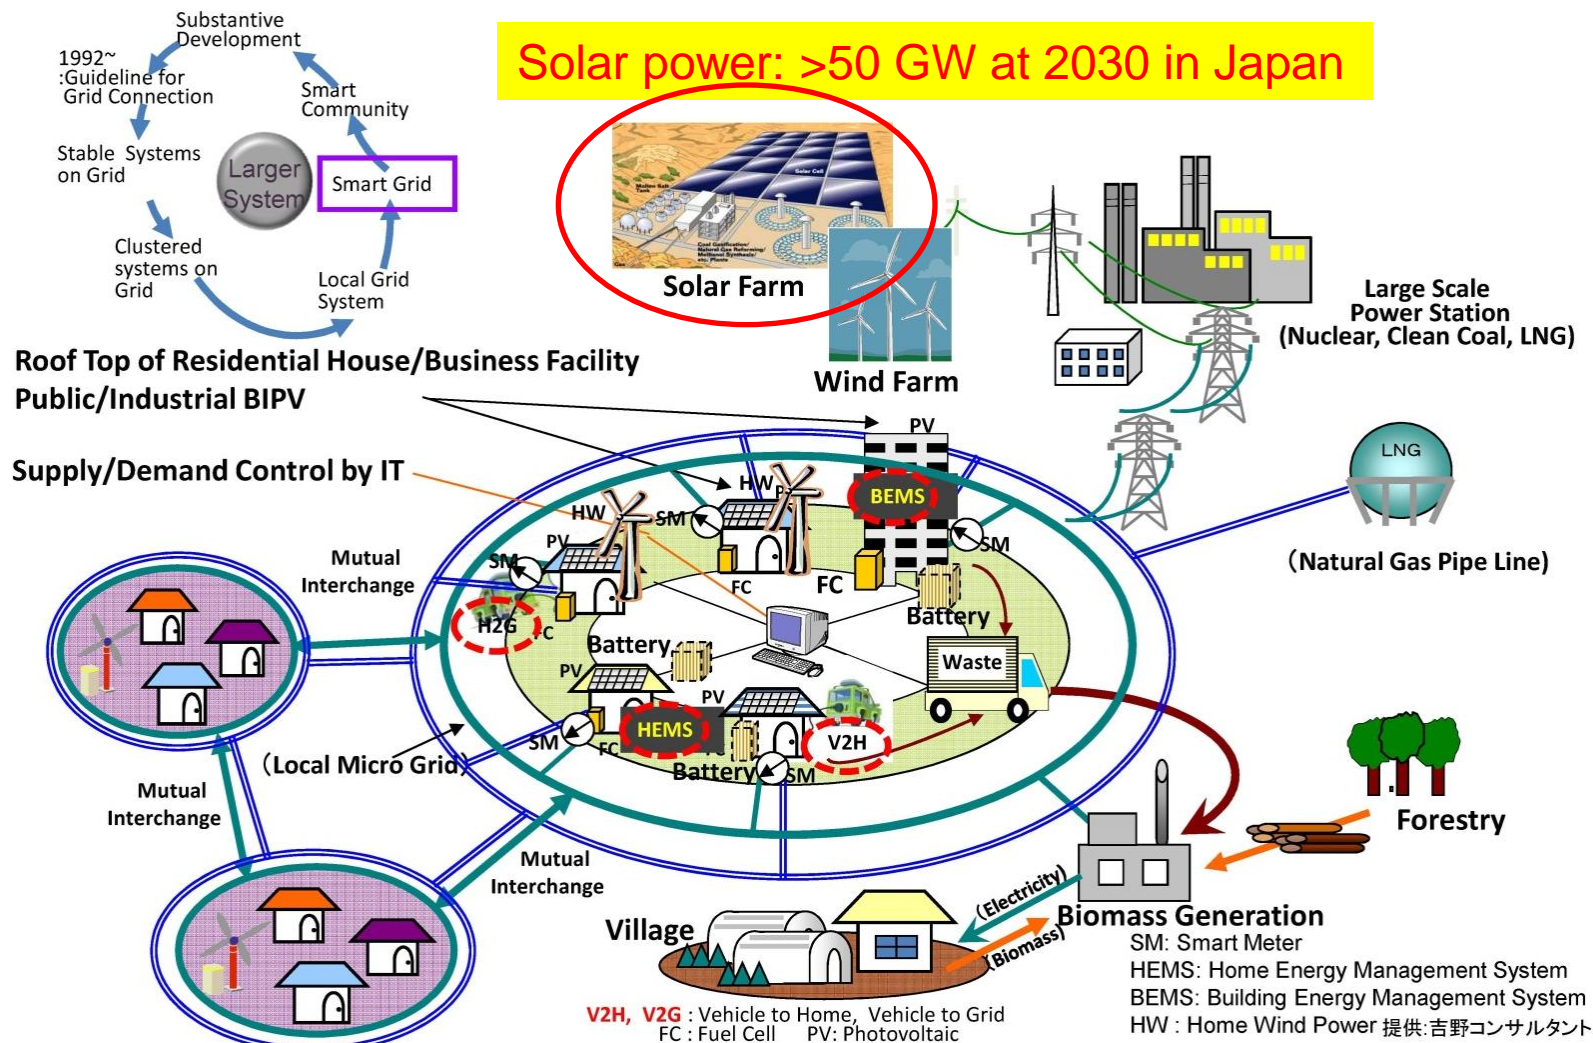

Agenda for the 2nd AAA Green-ILC WG meeting


Date: 8th May 2014 (Thu.) 13:30 - 17:00.

Place: 6th floor, UDX Building in Akihabara, Tokyo.

- 1) Collector Potential Depression (CPI) Klystron (30 min.)
by Toshiba Electron Tubes & Devices Co. Ltd.**
- 2) Power Saving of Large-Scaled Helium Compressor (30 min.)
by Mayekawa Manufacturing Company.**
- 3) Examples of New Energy Power Plants (20 min.)
by RIKEN.**
- 4) Solar Power Plant (40 min.)
by Japan Photovoltaic Energy Association**
- 5) Proposal of Biomass Power Plant for ILC (20 min.)
by Kabuki Construction Co. Ltd.**


Biomass Power Plant using Organic Waste

Conceptual Biomass Town around ILC

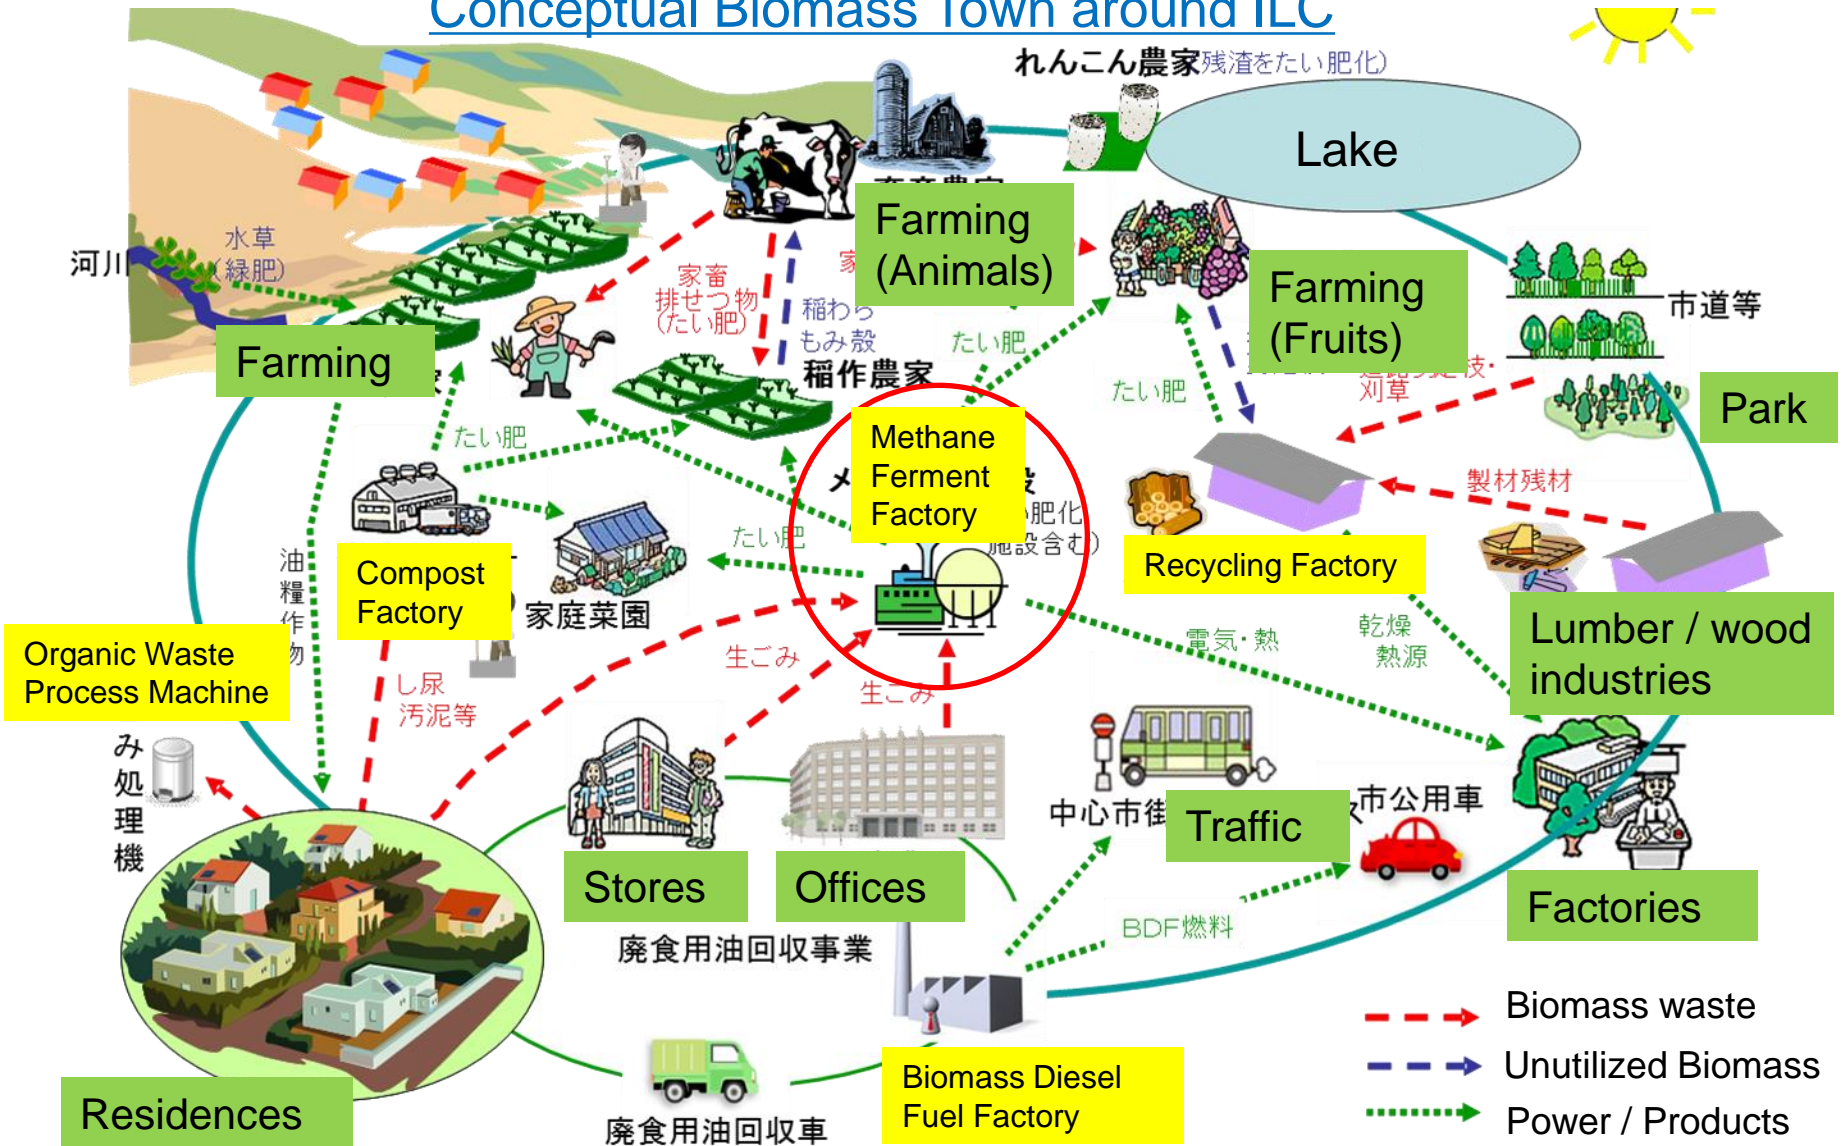

❑ Estimate of Biomass Electric Power

ILC (Tunnel Heat Waste)

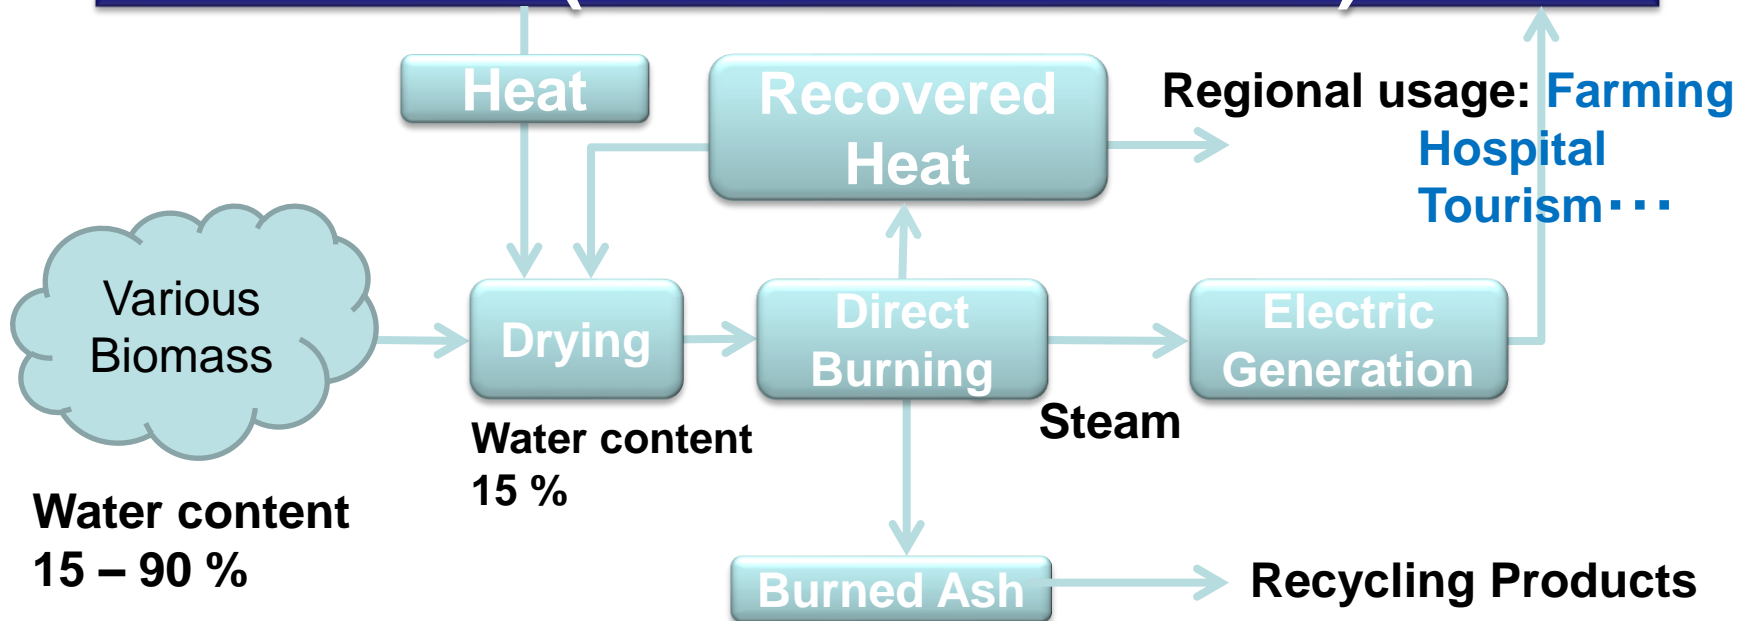

Estimate of Electric Power

Assuming the efficiency of 10~20%

Kitakami Site $58,104 \text{ kW} \times 10 \sim 20\% = 6,000 \sim 10,000 \text{ kW}$


Sefuri Site $43,280 \text{ kW} \times 10 \sim 20\% = 5,000 \sim 10,000 \text{ kW}$

Summary

- The 1st meeting for the Green-ILC WG of AAA was held on 25th February 2014 to launch the Green-ILC activity.
- The 2nd Green-ILC WG meeting was held on 5th May 2014 in Tokyo/Japan. Some realistic technologies of energy-saving for ILC were proposed and discussed by industries and scientists.
 - 1) Collector Potential Depression (CPI) Klystron (30 min.)
by Toshiba Electron Tubes & Devices Co. Ltd.
 - 2) Power Saving of Large-Scaled Helium Compressor (30 min.)
by Mayekawa Manufacturing Company.
 - 3) Examples of New Energy Power Plants (20 min.)
by RIKEN.
 - 4) Solar Power Plant (40 min.)
by Japan Photovoltaic Energy Association
 - 5) Proposal of Biomass Power Plant for ILC (20 min.)
by Kabuki Construction Co. Ltd.
- Proposed items for energy-saving for ILC might be summarized and written in the report under the framework of AAA.


Backup slides

Simplified Schematic Concept

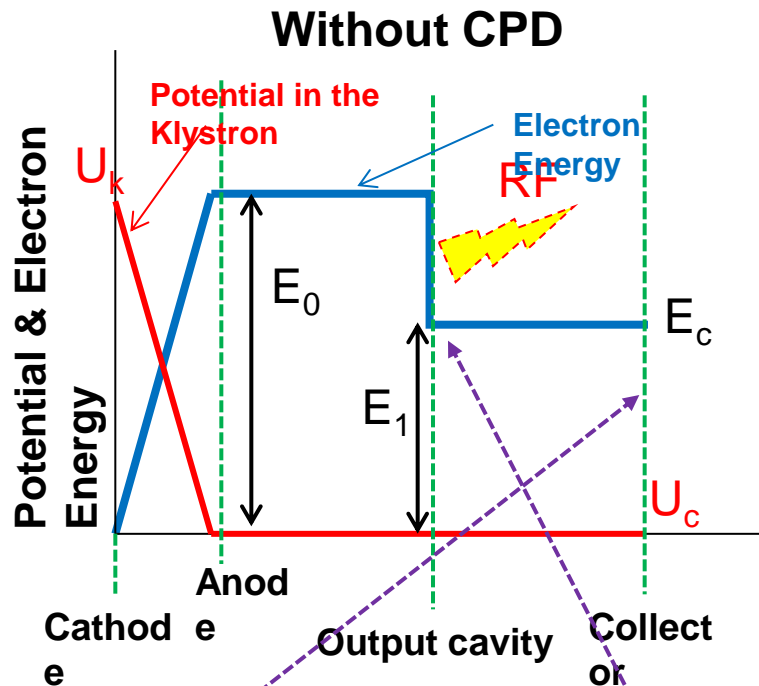

Efficiency of RF Conversion (40-50) %

Heat Loss

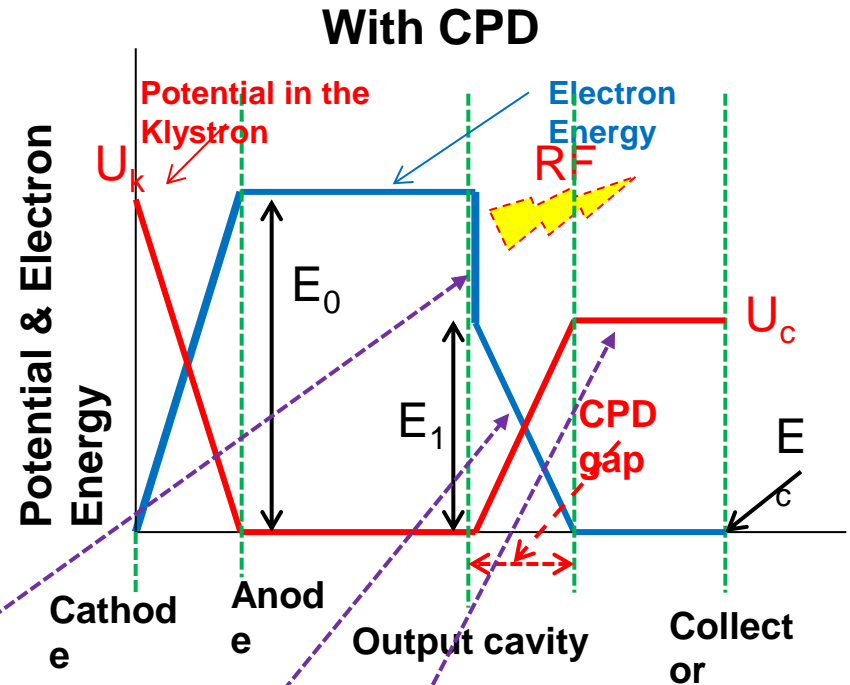

Beam Deceleration

Energy Recovery/Reuse



Potential denotes the electron potential energy, eV. For simplicity, input and intermediate cavities are omitted here and the anode potential is set to zero.

Issues must be addressed for CPD

(I) Energy spread

Klystron

The spent electron beam has **large energy spread** through electromagnetic interaction in the cavities. Therefore, **the collector potential cannot be increased beyond the lower limit of energy distribution** of the spent electron beam, otherwise backward electrons hit the cavities or the gun, and then deteriorate the klystron performance.

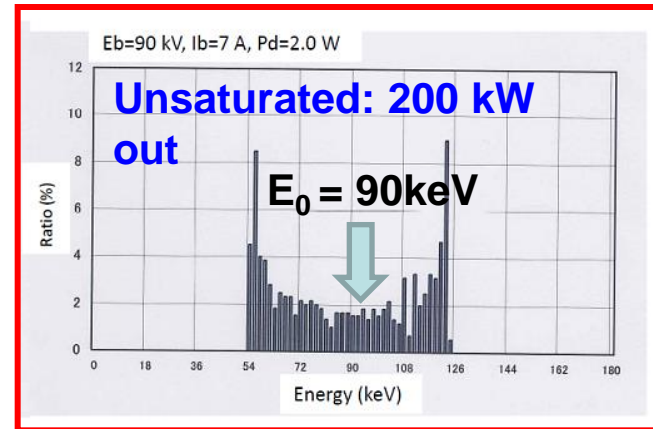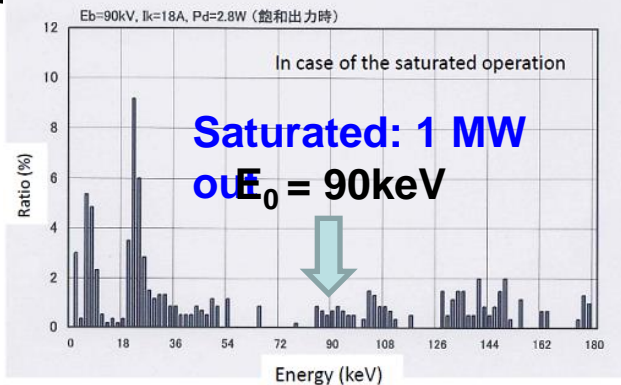


(II) Pulse-to-DC conversion

The spent electron beam is longitudinally bunched, so that **pulsed voltage is induced on the collector**. An **adequate pulse-to-DC converter** has to be implemented.

(III) RF Leakage

CPD klystron has to be equipped with an **insulator between the collector and the body column** in order to apply CPD voltage to the collector. Thus, it would be possible for the CPD klystron to **leak rf power** out more or less from the insulator.

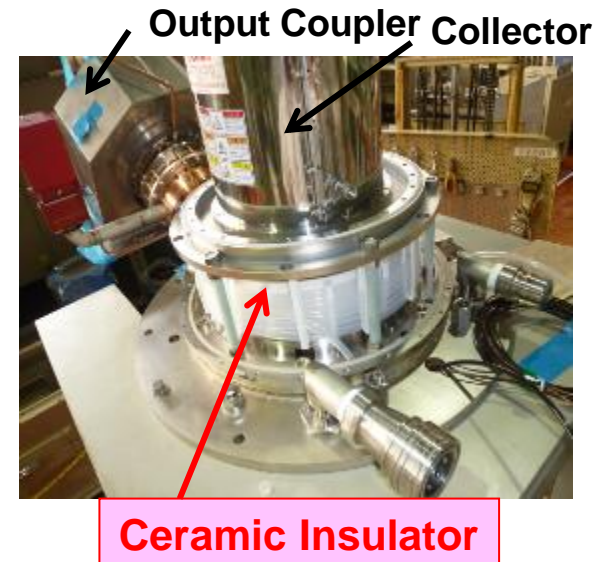


Adsorption chiller “AdRef”


Environmentally Friendly Chiller.

Features

1. No CFCs, HCFCs used.
Water (H₂O) is used as refrigerant.
2. Low temperature heat source.
As low as 65 C
3. Super Energy Saving
Only a few HP necessary
4. Easy maintenance
Very few moving parts used.
5. Safe
No pressure piping or refrigerant

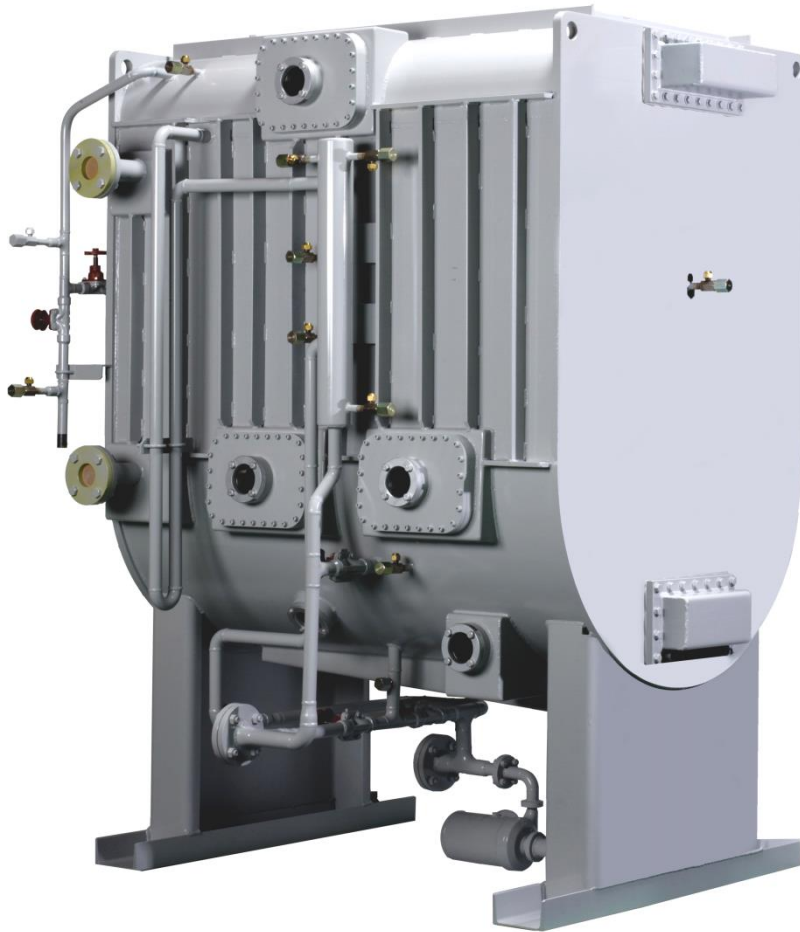

Adsorption chiller “AdRef”

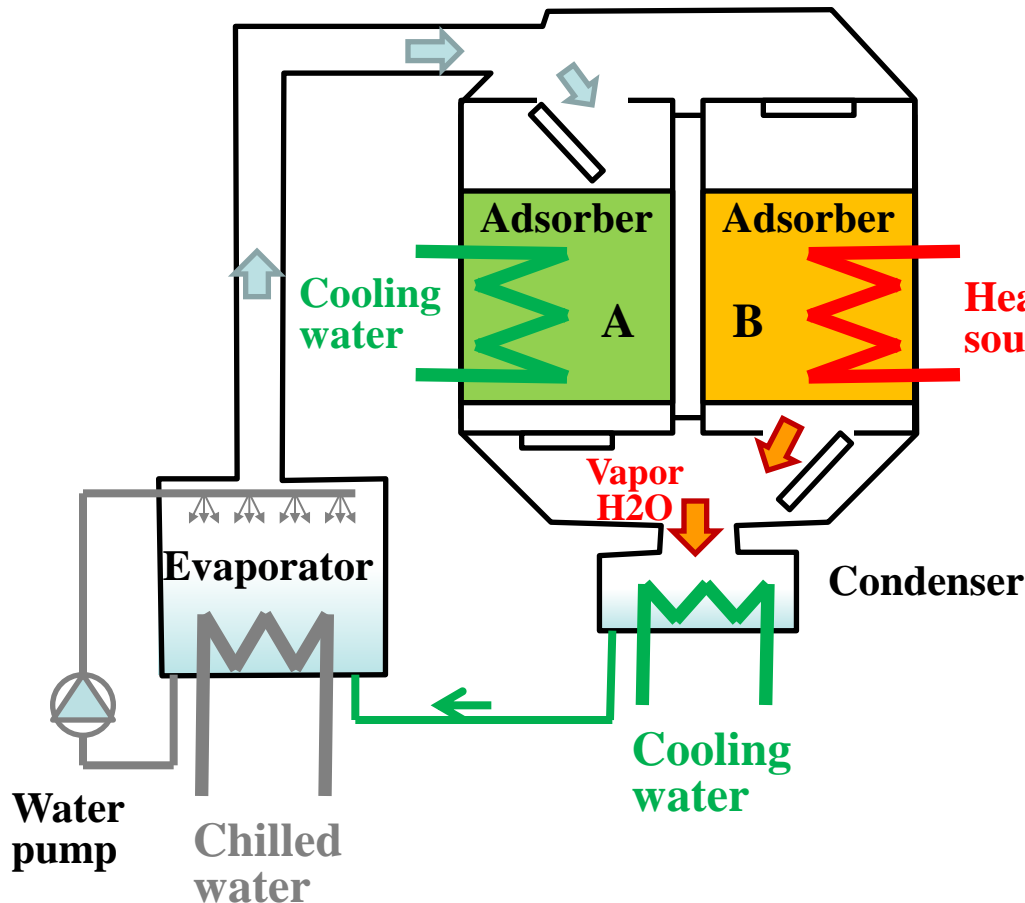


Vapor H₂O is removed from adsorber “B” by heating with warm water, and condensed in the condenser by the cool of cooling water.

Liquid water goes to the evaporator.

The adsorber “A” adsorb vapor H₂O by cool of cooling water.

Then the liquid H₂O in the evaporator evaporates, and the latent heat cool down the chilled water.

Adsorption chiller “AdRef”

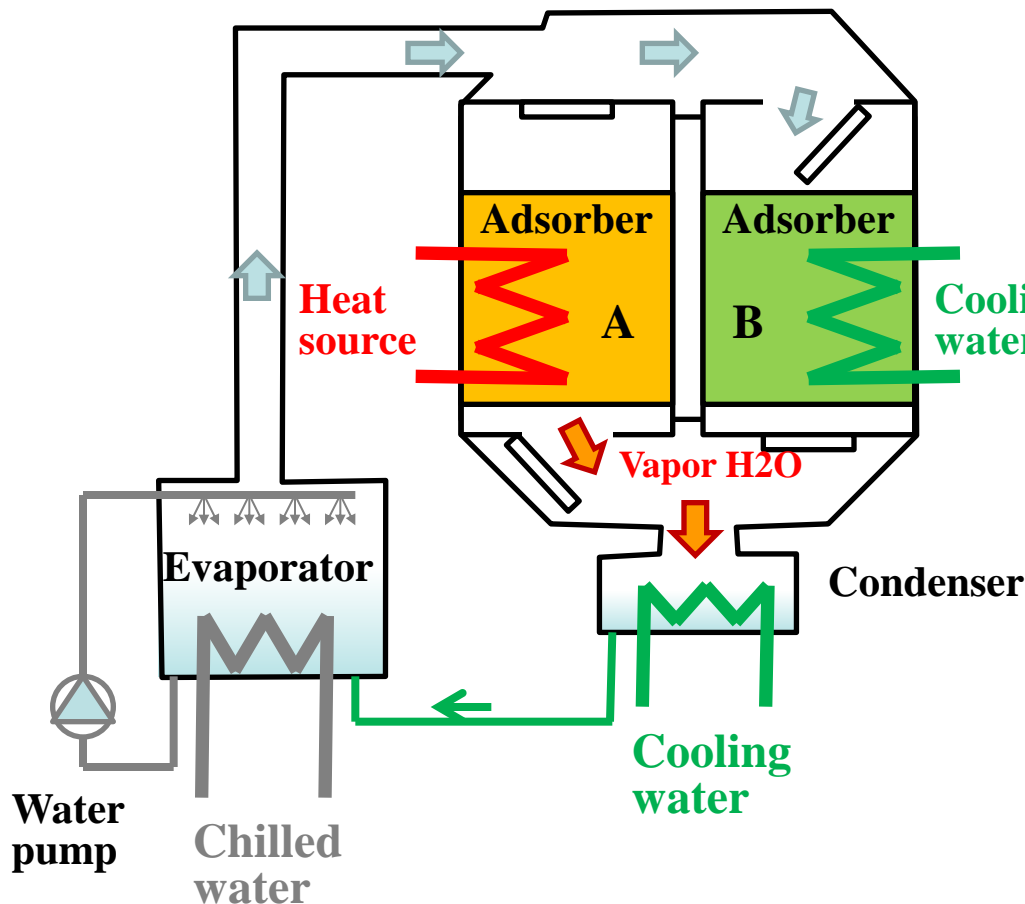

Vapor H₂O is removed from adsorber “B” by heating with warm water, and condensed in the condenser by the cool of cooling water.

Liquid water goes to the evaporator.

The adsorber “A” adsorb vapor H₂O by cool of cooling water.

Then the liquid H₂O in the evaporator evaporates, and the latent heat cool down the chilled water.

Heating/Cooling of adsorber A/B is switched periodically.

Absorption refrigerator (chiller)

(from Wikipedia, the free encyclopedia)

- An **absorption refrigerator** is a [refrigerator](#) that uses a heat source (e.g., [solar](#), kerosene-fueled flame, waste heat from factories or district heating systems) to provide the energy needed to drive the cooling system.
- In the early years of the twentieth century, the vapor absorption cycle using water-ammonia systems was popular and widely used, but after the development of the [vapor compression cycle](#) it lost much of its importance because of its low [coefficient of performance](#) (about one fifth of that of the vapor compression cycle). Nowadays, the vapor absorption cycle is used only where waste heat is available or where heat is derived from [solar collectors](#). Absorption refrigerators are a popular alternative to regular compressor refrigerators where electricity is unreliable, costly, or unavailable, where noise from the compressor is problematic, or where surplus heat is available (e.g., from turbine exhausts or industrial processes, or from solar plants).